


# DISCHARGE PRESSURE COMPARISON TEST

R-12, R-406a, HC-12a

Meat Display Case, Hussman Model #C1-10

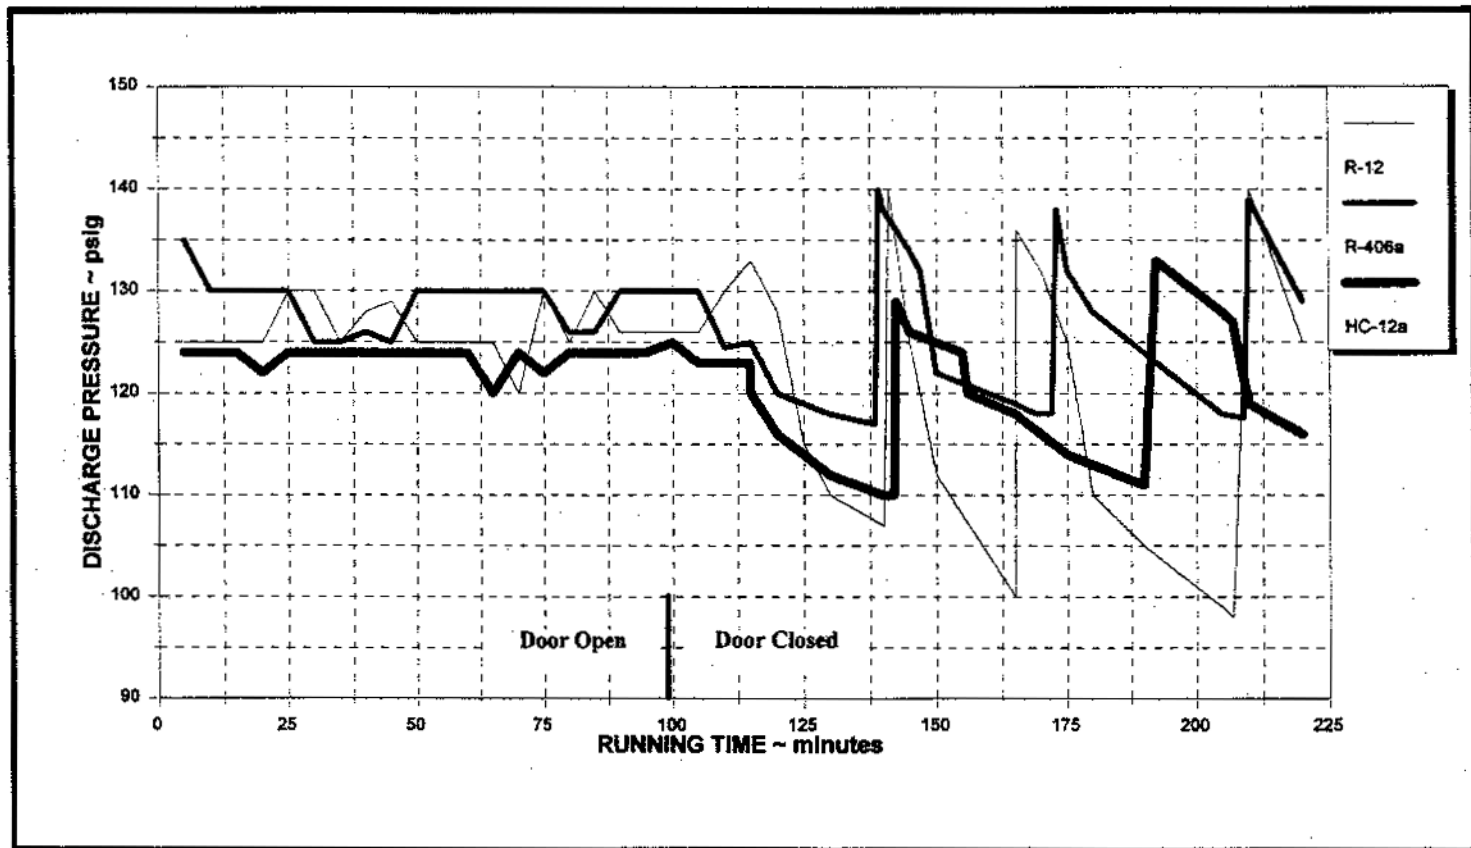

NOTE: Tests were run under the following conditions: Display case temperature was maintained between 35°F. and 38°F. Relative humidity was 79%. The meatcase door remained open for the first 110 minutes of the tests so that the unit would continue to operate. The door was closed for the remaining testing time.