


# SUCTION PRESSURE COMPARISON TEST

MP-39, R-406a, HC-12a  
230ft<sup>3</sup> Walk-in Cooler

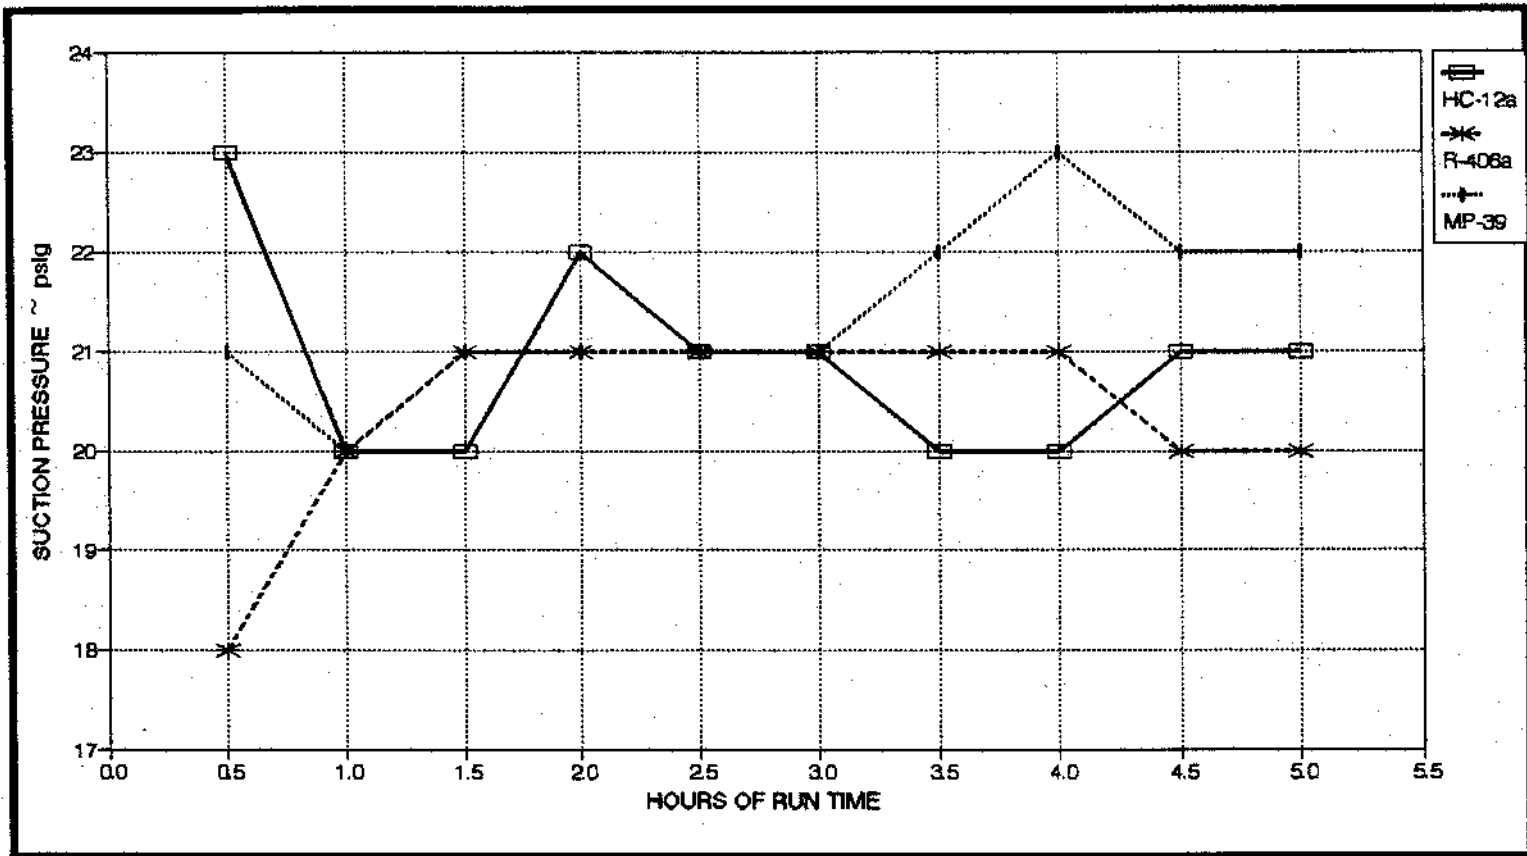

NOTE: Walk-in temperatures ran between 33°F. and 38°F. Ambient temperature averaged 75°F. Operating FLA were as follows:

HC-12a - 8.5 to 9 Amps

R-406a - 9 to 9.5 Amps

MP-39 - 10 Amps